



SS SEALS

LP1004SS, LP1504SS, LP2004SS

Our SS door seal with polypropylene brush pile offers fire + smoke protection. Available in a choice of sizes to cover 30 + 60 minute applications.

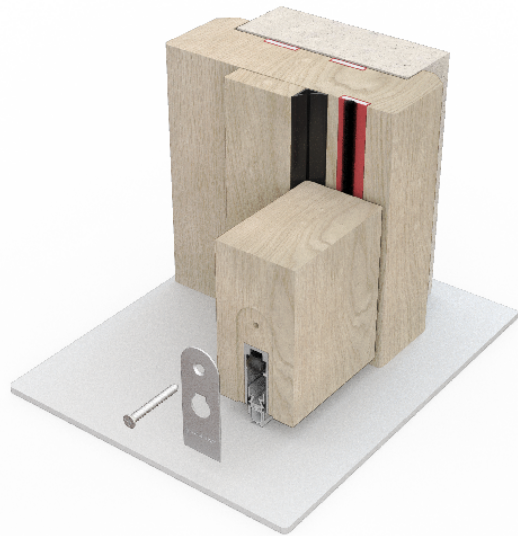

▲ **FD30 example:**
SS seal with Batwing® to comply with BS 9999 (Shown with LAS8001 si + Batwing®)

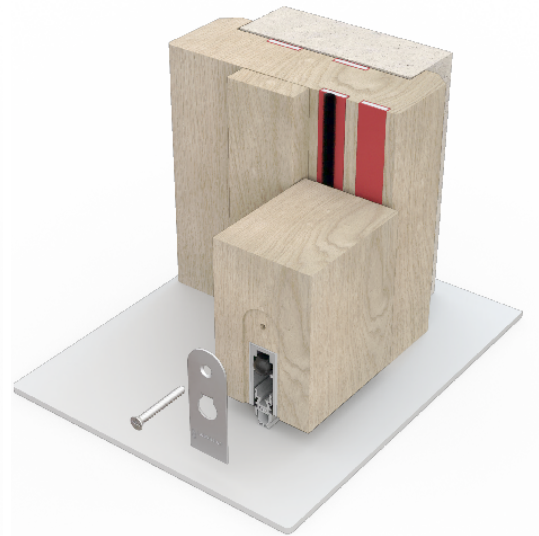

▲ **FD60 example:**
SS seal (Shown with with LP1504 fire seal & LAS8001 si + cladding kit)

▶▶ **Note:** It's essential to consult the manufacturer to determine exactly what configuration of seal & size of seal have been tested.

SYSTEM SPECIFICATIONS

Test evidence

- ▶ Fire: BS 476-22:1987 & BS EN 1634-1:2008.
- ▶ Smoke: BS 476-31.1: 1983 at ambient temperature.
- ▶ Assessment: CNA/F14171.
- ▶ Durability: 100,000 cycles.

Performance

- ▶ Meets smoke requirements BS 9999:2017.
- ▶ Protects against smoke and fire.
- ▶ Low frictional resistance for ease of door operation.

Location

- ▶ Single and double leaf doors.

Min/max gap size

- ▶ 3mm/4mm

Size

- ▶ 10 x 4mm, 15 x 4mm, 20 x 4mm.
- ▶ Other sizes available, please ask for details.

Use with

- ▶ Any architectural seals.

Seal material

- ▶ PVC encased sodium silicate and polypropylene brush pile.

Standard lengths

- ▶ 1m and 2.1m.
- ▶ Other lengths to special order.

Fixing

- ▶ Heavy duty self-adhesive backing tape.

Finishes

- ▶ Black, white, dark brown, light brown and grey as standard.
- ▶ Cream, red, silver & woodgrains are subject to MOQs.
- ▶ Black brush as standard.

Certification